


Installation Instructions for LED T8




To avoid the risk of fire, or electric shock this product should be installed, inspected, and maintained by a qualified electrician only. Installation should be completely by an individual familiar with the construction and operation of the luminaire. Installation of luminaire must be in accordance with nation and local building and electrical codes.

AC 120 - 277V, 3 Operating Modes

One-end direct power, no ballast. Must use unshunted tombstones.

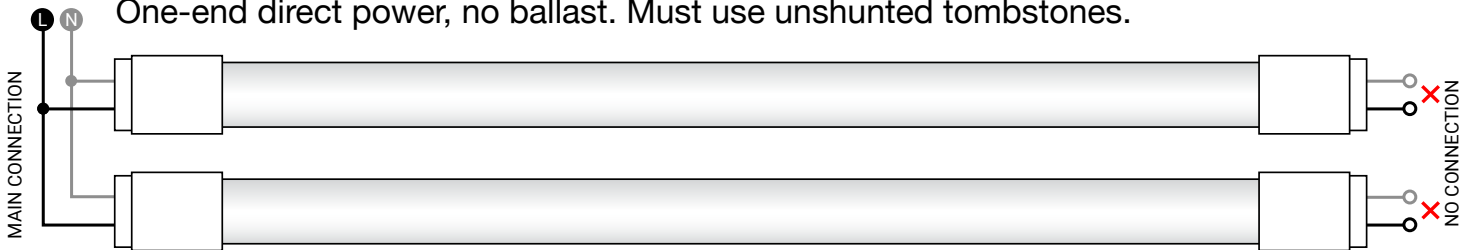

Two-end direct power, no ballast. Shunted or unshunted tombstones.

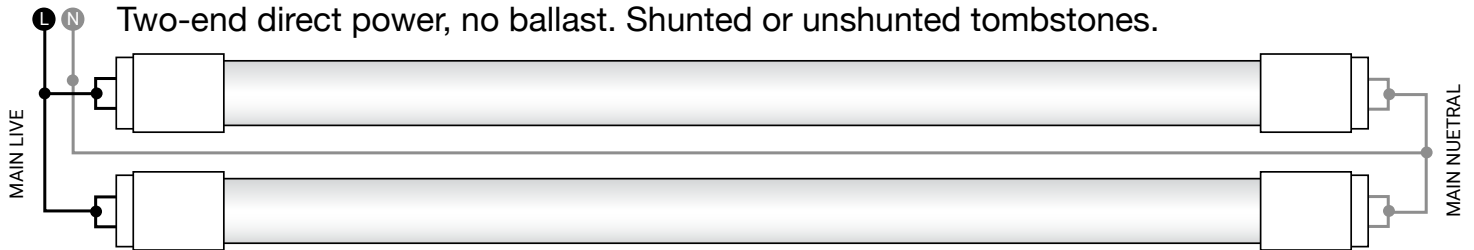

Two-end direct power, electronic ballast only.

