

EQUIVALENT SOUNDBSORPTION AREA PER OBJECT conform EN-ISO 354:2003



principal: BuzziSpace

#1; BuzziCee Half



Absorb, versie 5.10.2 mode 9, PM: JK, file: a4539 E#:1-36 F#:37-72 A#:73 T₁ = 15,8 °C T₂ = 16,2 °C p₁ = 101,4 kPa p₂ = 101,4 kPa h₁ = 56,7 % h₂ = 56,9 %


volume reverberation room
214 m³

number of elements measured
2

measured at
Peutz Laboratory for Acoustics

signal
broad-band noise

bandwidth
1/3 octave

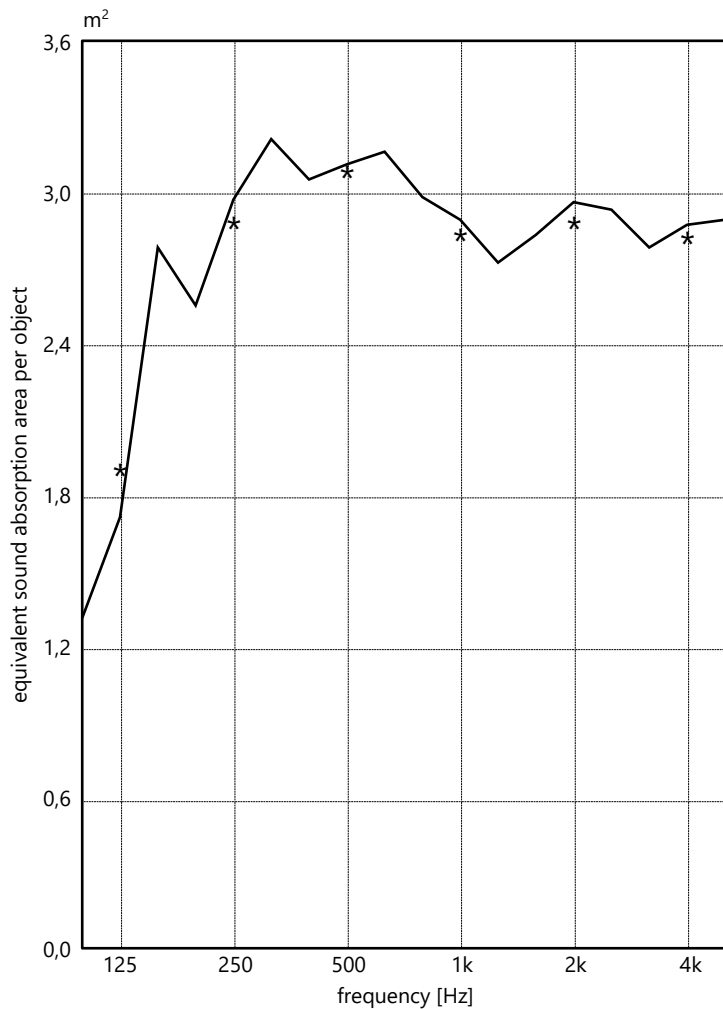

	125	250	500	1k	2k	4k
1/3 oct.	1,31	2,55	3,05	2,98	2,83	2,78
	1,71	2,97	3,11	2,89	2,96	2,87
	2,78	3,21	3,16	2,72	2,93	2,89
1/1 oct.	1,93	2,91	3,11	2,86	2,91	2,85

publication is permitted for the entire page only

RA

Mook, measured at 19-03-2024