

EQUIVALENT SOUNDABSORPTION AREA PER OBJECT conform EN-ISO 354:2003



principal: BuzziSpace

#3; BuzziHug Work



Absorb, versie 5.10.2 mode 9, PM: JK, file: a4539 E#:1-36 F#:111-146 A#:147 T₁ = 15,8 °C T₂ = 16,0 °C p₁ = 101,4 kPa p₂ = 101,4 kPa h₁ = 56,7 % h₂ = 57,4 %


volume reverberation room
214 m³

number of elements measured
1

measured at
Peutz Laboratory for Acoustics

signal
broad-band noise

bandwidth
1/3 octave

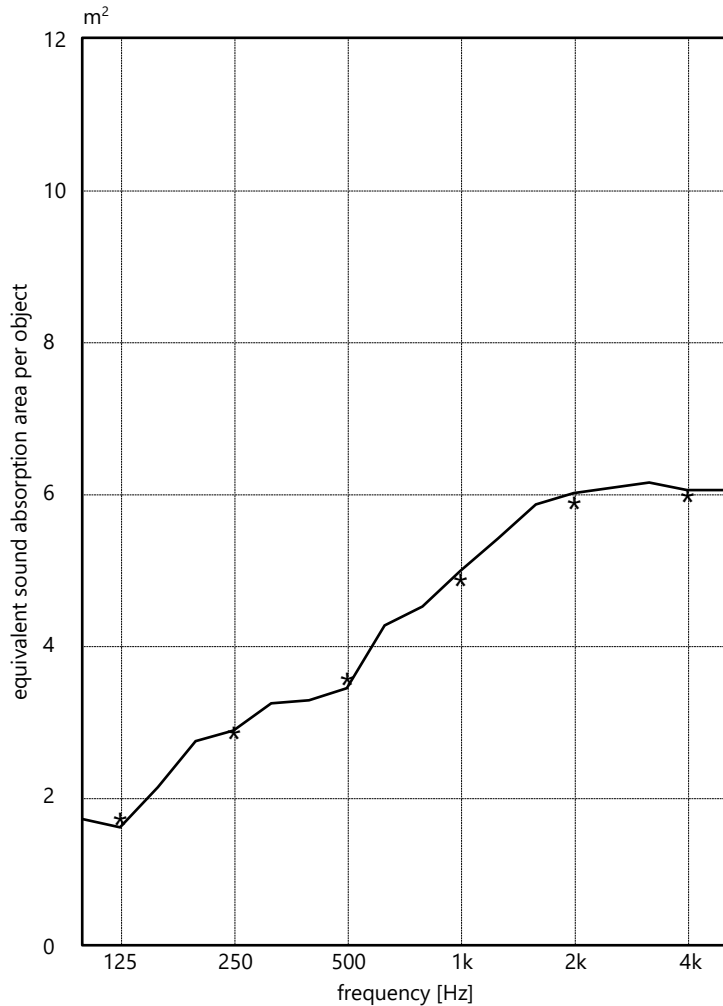

	125	250	500	1k	2k	4k
1/3 oct.	1,56	2,84	3,40	4,95	5,98	6,02
	2,09	3,20	4,23	5,38	6,05	6,02
1/1 oct.	1,77	2,91	3,62	4,94	5,95	6,05

— 1/3 oct.
* 1/1 oct.

publication is permitted for the entire page only

RA

Mook, measured at 19-03-2024